


Class 1/2 Certification – Abnormal Urinalysis

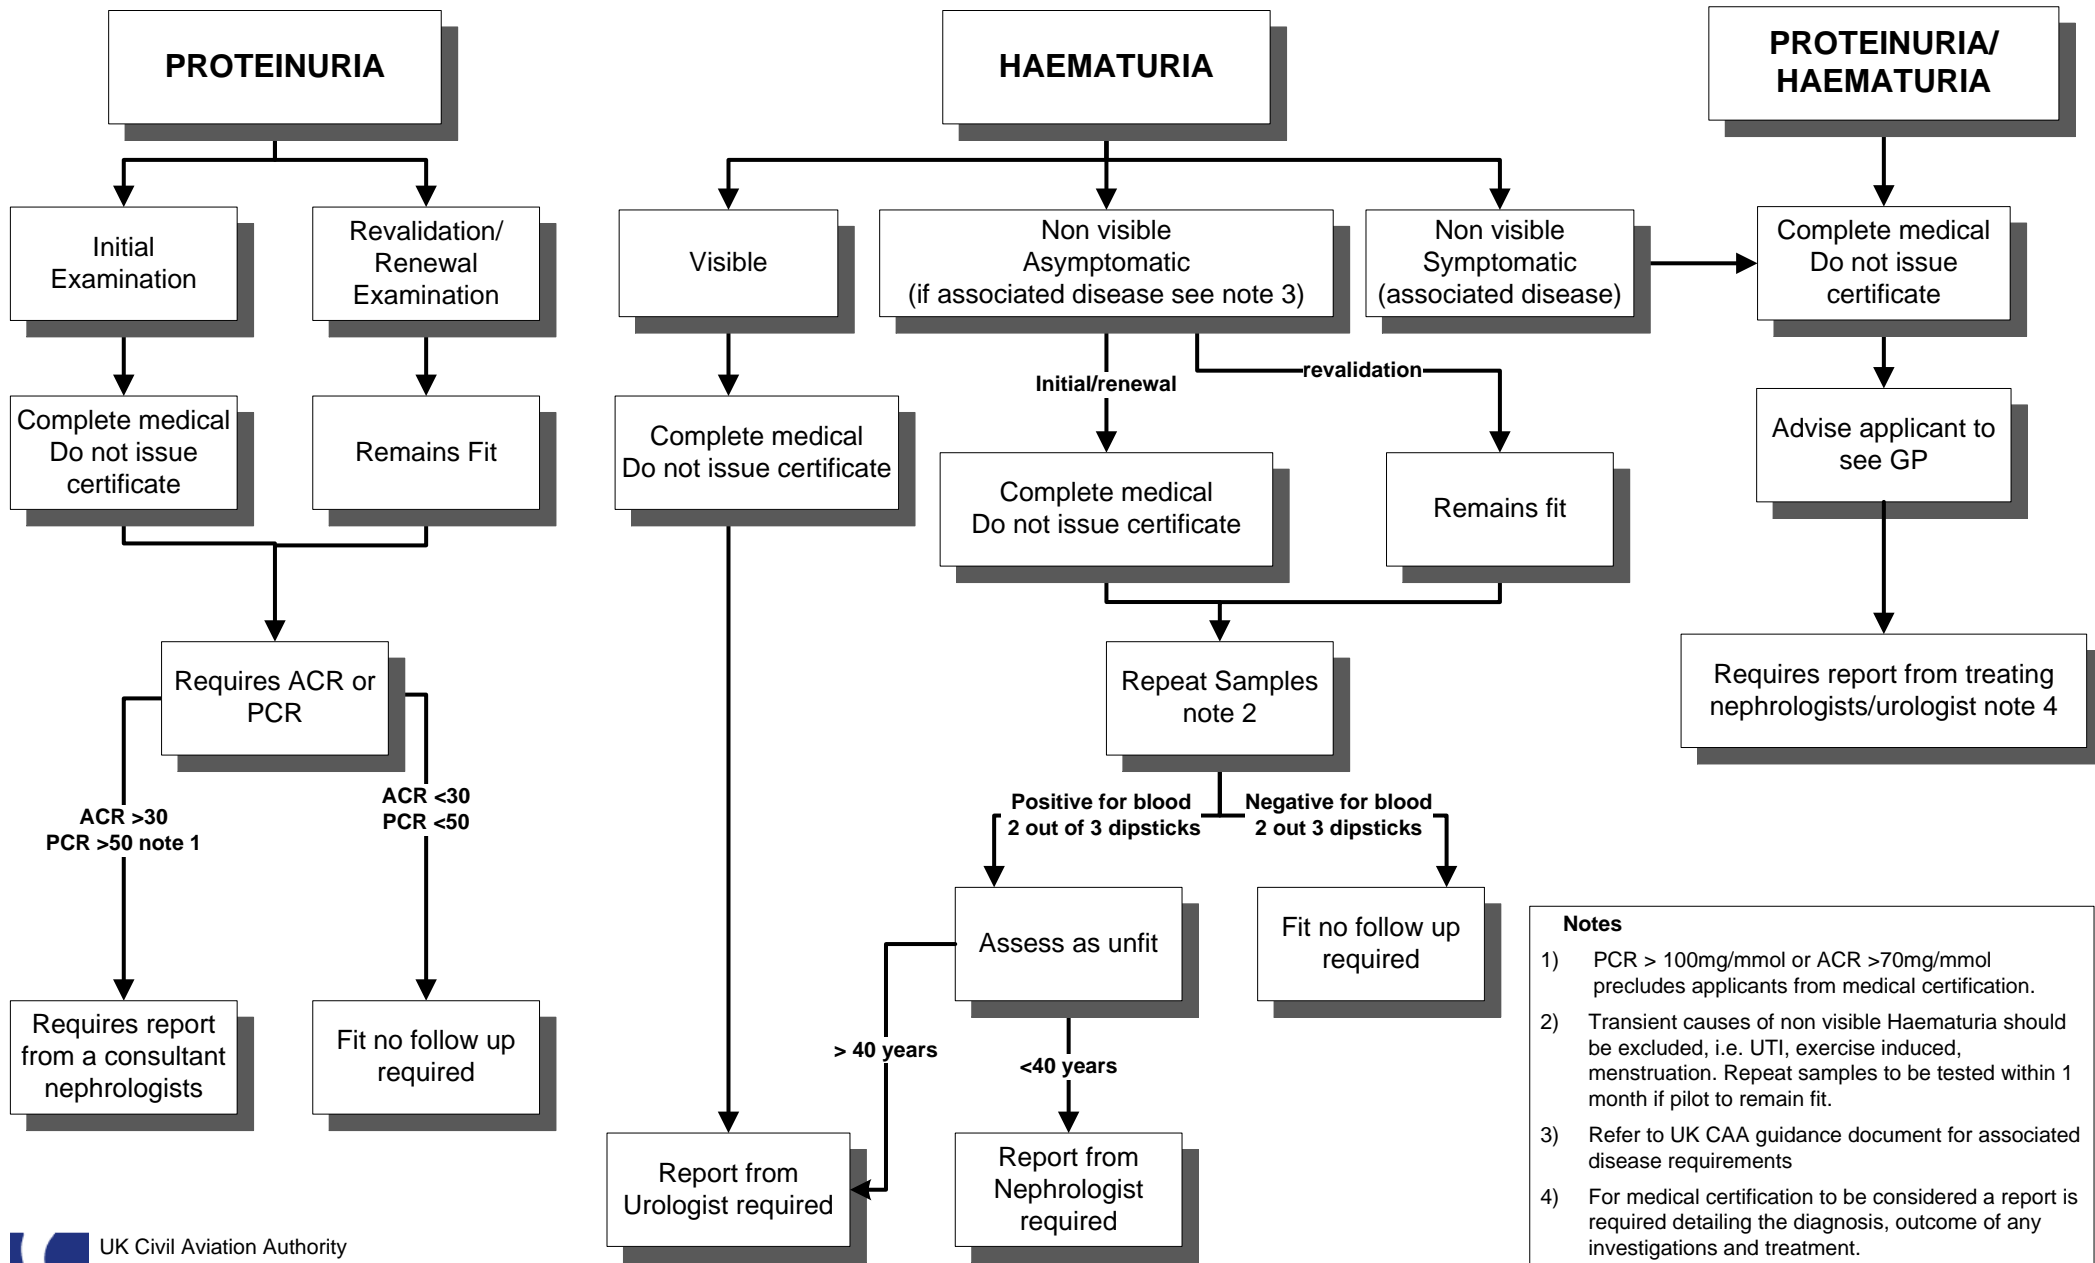

- Notes**
- 1) PCR > 100mg/mmol or ACR >70mg/mmol precludes applicants from medical certification.
 - 2) Transient causes of non visible Haematuria should be excluded, i.e. UTI, exercise induced, menstruation. Repeat samples to be tested within 1 month if pilot to remain fit.
 - 3) Refer to UK CAA guidance document for associated disease requirements
 - 4) For medical certification to be considered a report is required detailing the diagnosis, outcome of any investigations and treatment.